


SPLIT-TYPE, HEAT PUMP AIR CONDITIONERS

March 2019 No. OC307 REVISED EDITION-F

TECHNICAL & SERVICE MANUAL

Series PMFY Ceiling Cassettes R410A

Indoor unit [Model names]	[Service Ref.]
PMFY-P20VBM-E	PMFY-P20VBM-E
	PMFY-P20VBM-E#2
	PMFY-P20VBM-ER4
PMFY-P25VBM-E	PMFY-P25VBM-E
	PMFY-P25VBM-E#2
	PMFY-P25VBM-ER4
PMFY-P32VBM-E	PMFY-P32VBM-E
	PMFY-P32VBM-E#2
	PMFY-P32VBM-ER4
PMFY-P40VBM-E	PMFY-P40VBM-E
	PMFY-P40VBM-E#2
	PMFY-P40VBM-ER4



INDOOR UNIT

PMFY-P20VBM-E1 PMFY-P20VBM-ER3

PMFY-P25VBM-E1 PMFY-P25VBM-ER3

PMFY-P32VBM-E1 PMFY-P32VBM-ER3

PMFY-P40VBM-E1 PMFY-P40VBM-ER3

Revision:

• Some descriptions have been modified in REVISED EDITION-F.

OC307 REVISED EDITION-E is void.

CONTENTS

1. TECHNICAL CHANGES22. SAFETY PRECAUTION33. PART NAMES AND FUNCTIONS54. SPECIFICATIONS125. OUTLINES AND DIMENSIONS166. WIRING DIAGRAM177. REFRIGERANT SYSTEM DIAGRAM218. TROUBLESHOOTING229. DISASSEMBLY PROCEDURE3210. SERVICE PARTS LIST36

CITY MULTI

1

PMFY-P20VBM-ER3 -> PMFY-P20VBM-ER4 PMFY-P25VBM-ER3 -> PMFY-P25VBM-ER4 PMFY-P32VBM-ER3 -> PMFY-P32VBM-ER4 PMFY-P40VBM-ER3 -> PMFY-P40VBM-ER4 1. INDOOR CONTROLLER BOARD has been changed. (S/W version up) PMFY-P20VBM-E#2 -> PMFY-P20VBM-ER3 PMFY-P25VBM-E#2 -> PMFY-P25VBM-ER3 PMFY-P32VBM-E#2 -> PMFY-P32VBM-ER3 PMFY-P40VBM-E#2 -> PMFY-P40VBM-ER3 1. DRAIN PIPE has been changed. 2. JOINT SOCKET (FOR DRAIN PIPE) has been added. PMFY-P32VBM-E1 → PMFY-P32VBM-E#2 → PMFY-P40VBM-E#2 PMFY-P40VBM-E1 1. CONTROLLER BOARD (I.B) has been changed. 2. PANEL has been changed. PMP-40BM PMP-40BMW \rightarrow (White : 0.98Y 8.99/0.63) (Pure white : 6.4Y 8.9/0.4) 3. FAN MOTOR (MF) has been changed. 4. THERMISTOR (TH22, TH23) have been changed. PMFY-P20VBM-E → PMFY-P20VBM-E1 PMFY-P25VBM-E → PMFY-P25VBM-E1 PMFY-P32VBM-E → PMFY-P32VBM-E1 PMFY-P40VBM-E → PMFY-P40VBM-E1

1. FAN MOTOR (MF) has been changed.

2. CONTROLLER BOARD (I.B) has been changed.

Cautions for units utilizing refrigerant R410A

Use new refrigerant pipes.

In case of using the existing pipes for R22, be careful with the followings.

• Change flare nut to the one provided with this product. Use a newly flared pipe.

Avoid using thin pipes.

2

Make sure that the inside and outside of refrigerant piping is clean and it has no contaminants such as sulfur, oxides, dirt, shaving particles, etc, which are hazard to refrigerant cycle. In addition, use pipes with specified thickness.

Contamination inside refrigerant piping can cause deterioration of refrigerant oil etc.

Store the piping indoors, and both ends of the piping sealed until just before brazing. (Leave elbow joints, etc. in their packaging.)

If dirt, dust or moisture enters into refrigerant cycle, that can cause deterioration of refrigerant oil or malfunction of compressor.

The refrigerant oil applied to flare and flange connections must be ester oil, ether oil or alkylbenzene oil in a small amount.

If large amount of mineral oil enters, that can cause deterioration of refrigerant oil etc.

Charge refrigerant from liquid phase of gas cylinder.

If the refrigerant is charged from gas phase, composition change may occur in refrigerant and the efficiency will be lowered.

Do not use refrigerant other than R410A.

If other refrigerant (R22 etc.) is used, chlorine in refrigerant can cause deterioration of refrigerant oil etc.

Use a vacuum pump with a reverse flow check valve.

Vacuum pump oil may flow back into refrigerant cycle and that can cause deterioration of refrigerant oil etc.

Use the following tools specifically designed for use with R410A refrigerant.

The following tools are necessary to use R410A refrigerant.

Tools for R410A					
Gauge manifold	Flare tool				
Charge hose	Size adjustment gauge				
Gas leak detector	Vacuum pump adaptor				
Torque wrench	Electronic refrigerant				
	charging scale				

Handle tools with care.

If dirt, dust or moisture enters into refrigerant cycle, that can cause deterioration of refrigerant oil or malfunction of compressor.

Do not use a charging cylinder.

If a charging cylinder is used, the composition of refrigerant will change and the efficiency will be lowered.

Use the specified refrigerant only.

Never use any refrigerant other than that specified. Doing so may cause a burst, an explosion, or fire when the unit is being used, serviced, or disposed of. Correct refrigerant is specified in the manuals and on the spec labels provided with our products. We will not be held responsible for mechanical failure, system malfunction, unit breakdown or accidents caused by failure to follow the instructions.


Ventilate the room if refrigerant leaks during operation. If refrigerant comes into contact with a flame, poisonous gases will be released.

[1] Cautions for service

- (1) Perform service after recovering the refrigerant left in unit completely.
- (2) Do not release refrigerant in the air.
- (3) After completing service, charge the cycle with specified amount of refrigerant.
- (4) When performing service, install a filter drier simultaneously.
- Be sure to use a filter drier for new refrigerant.

[2] Additional refrigerant charge

- When charging directly from cylinder
- · Check that cylinder for R410A on the market is syphon type.
- · Charging should be performed with the cylinder of syphon stood vertically. (Refrigerant is charged from liquid phase.)

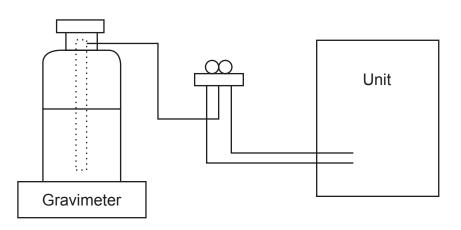

[3] Service tools


Use the below service tools as exclusive tools for R410A refrigerant.

No.	Tool name	Specifications			
1	Gauge manifold	· Only for R410A			
		· Use the existing fitting specifications. (UNF1/2)			
		· Use high-tension side pressure of 5.3MPa·G or over.			
2	Charge hose	· Only for R410A			
		· Use pressure performance of 5.09MPa·G or over.			
3	Electronic scale	_			
(4)	Gas leak detector	· Use the detector for R134a, R407C or R410A.			
5	Adapter for reverse flow check	· Attach on vacuum pump.			
6	Refrigerant charge base				
0	Refrigerant cylinder	· Only for R410A · Top of cylinder (Pink)			
		· Cylinder with syphon			
8	Refrigerant recovery equipment	—			

PART NAMES AND FUNCTIONS

3-1. Indoor Unit

3

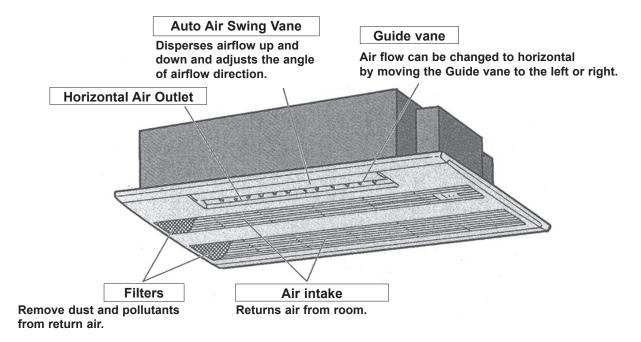


3-2. WIRED REMOTE CONTROLLER <PAR-30MAA/PAR-31MAA>

Wired remote controller function

* The functions which can be used are restricted according to the model.

	Function	PAR-30MAA/	PAR-30MAA/PAR-31MAA		
	Function	Slim	CITY MULTI	PAR-21MAA	
Body	Product size H × W × D (mm)	120 × 12	20 × 19	120 × 130 × 19	
	LCD	Full Do	t LCD	Partial Dot LCD	
	Backlight	C)	×	
Energy-saving	Energy-saving operation schedule	0	×	×	
	Automatic return to the preset temperature	C)	×	
Restriction	Setting the temperature range restriction	0		0	
Function	Operation lock function	0		0	
	Weekly timer	C	×		
	On / Off timer	0		0	
High Power		0	×	×	
	Manual vane angle)	0	



1 ON / OFF button

Press to turn ON/OFF the indoor unit.

2 SELECT button

Press to save the setting.

3 RETURN button

Press to return to the previous screen.

(4) MENU button

Press to bring up the Main menu.

5 Backlit LCD


Operation settings will appear. When the backlight is off, pressing any button turns the backlight on and it will stay lit for a certain period of time depending on the screen.

When the backlight is off, pressing any button turns the backlight on and does not perform its function. (except for the (\circ) (ON / OFF) button)

The functions of the function buttons change depending on the screen. Refer to the button function guide that appears at the bottom of the LCD for the functions they serve on a given screen.

O · Supported X · Unsupported

When the system is centrally controlled, the button function guide that corresponds to the locked button will not appear.

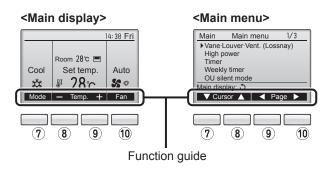

6 ON / OFF lamp

This lamp lights up in green while the unit is in operation. It blinks while the remote controller is starting up or when there is an error.

? Function button **F1**

Main display : Press to change the operation mode. Main menu : Press to move the cursor down.

8 Function button F2

Main display : Press to decrease temperature. Main menu : Press to move the cursor up.

9 Function button **F3**

Main display : Press to increase temperature. Main menu : Press to go to the previous page.

10 Function button F4


Main display : Press to change the fan speed. Main menu : Press to go to the next page.

The main display can be displayed in two different modes: "Full" and "Basic".

The factory setting is "Full". To switch to the "Basic" mode, change the setting on the Main display setting.


<Full mode>

<Basic mode>

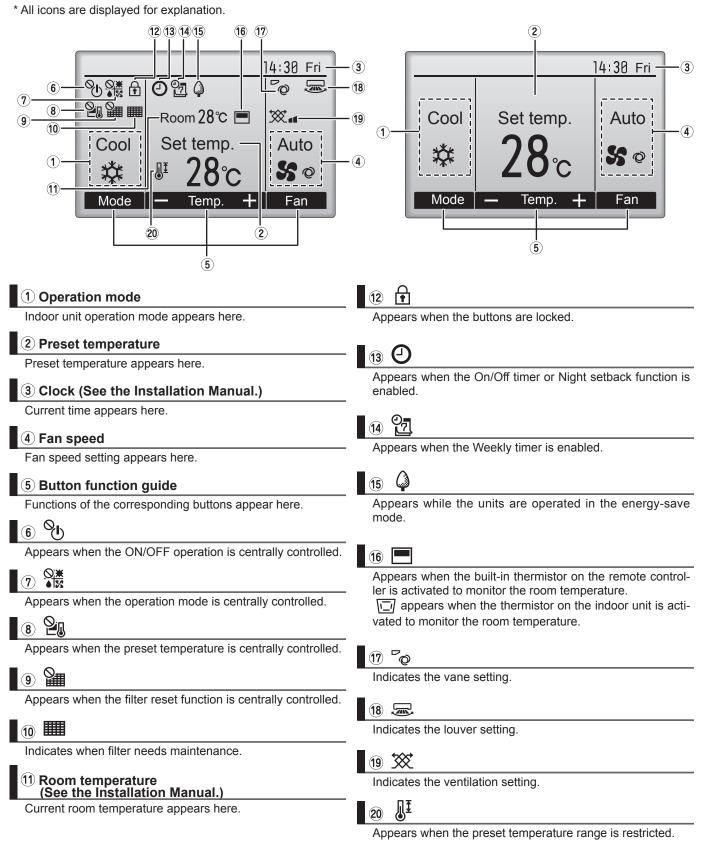

Most settings (except ON / OFF, mode, fan speed, temperature) can be made from the Menu screen.

Menu structure

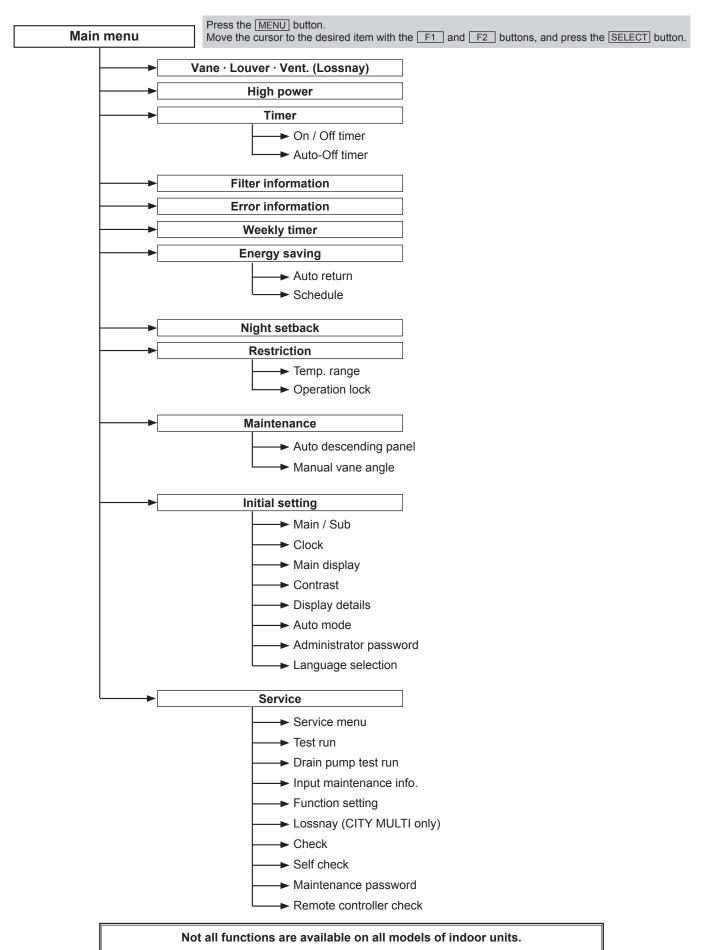


Main menu list

Setting and display items		Setting details				
Vane · Louver · Vent. (Lossnay)		 Use to set the vane angle. Select a desired vane setting from five different settings. Use to turn ON / OFF the louver. Select a desired setting from "ON" and "OFF." Use to set the amount of ventilation. Select a desired setting from "Off," "Low," and "High." 				
High power		Use to reach the comfortable room temperature quickly. • Units can be operated in the High-power mode for up to 30 minutes.				
Timer	On/Off timer	Use to set the operation On/Off times. • Time can be set in 5-minute increments. * Clock setting is required.				
	Auto-Off timer	Use to set the Auto-Off time. • Time can be set to a value from 30 to 240 in 10-minute increments.				
Filter information	tion	Use to check the filter status. • The filter sign can be reset.				
Error information	tion	 Use to check error information when an error occurs. Error code, error source, refrigerant address, unit model, manufacturing number, contact information (dealer's phone number) can be displayed. * The unit model, manufacturing number, and contact information need to be registered in advance to be displayed. 				
Weekly timer		Use to set the weekly operation On / Off times. • Up to eight operation patterns can be set for each day. * Clock setting is required. * Not valid when the On/Off timer is enabled.				
Energy saving	Auto return	Use to get the units to operate at the preset temperature after performing energy-save operation for a specified time period. • Time can be set to a value from 30 and 120 in 10-minute increments. * This function will not be valid when the preset temperature ranges are restricted.				
	Schedule	 Set the start/stop times to operate the units in the energy-save mode for each day of the week, and set the energy-saving rate. Up to four energy-save operation patterns can be set for each day. Time can be set in 5-minute increments. Energy-saving rate can be set to a value from 0% or 50 to 90% in 10% increments. * Clock setting is required. 				
Night setback		 Use to make Night setback settings. Select "Yes" to enable the setting, and "No" to disable the setting. The temperature range and the start/stop times can be set. * Clock setting is required. 				
Restriction	Temp. range	Use to restrict the preset temperature range. • Different temperature ranges can be set for different operation modes.				
	Operation lock	Use to lock selected functions. • The locked functions cannot be operated.				
Maintenance	Auto descending panel	Auto descending panel (Optional parts) Up / Down you can do.				
	Manual vane angle	Use to set the vane angle for each vane to a fixed position.				
Initial setting	Main/Sub	When connecting two remote controllers, one of them needs to be designated as a sub controller.				
	Clock	Use to set the current time.				
	Main display	Use to switch between "Full" and "Basic" modes for the Main display. • The default setting is "Full."				
	Contrast	Use to adjust screen contrast.				

Setting and	display items	Setting details				
Initial setting	Display details	Make the settings for the remote controller related items as necessary. Clock: The factory settings are "Yes" and "24h" format. Temperature: Set either Celsius (°C) or Fahrenheit (°F). Room temp. : Set Show or Hide. Auto mode: Set the Auto mode display or Only Auto display.				
	Auto mode	Whether or not to use the AUTO mode can be selected by using the button. This setting is valid only when indoor units with the AUTO mode function are connected.				
	Administrator password	 The administrator password is required to make the settings for the following items. Timer setting • Energy-save setting • Weekly timer setting Restriction setting • Outdoor unit silent mode setting • Night set back 				
	Language selection	Use to select the desired language.				
Service	Test run	Select "Test run" from the Service menu to bring up the Test run menu. • Test run • Drain pump test run				
	Input maintenance	Select "Input maintenance Info." from the Service menu to bring up the Maintenance information screen. The following settings can be made from the Maintenance Information screen. • Model name input • Serial No. input • Dealer information input				
	Function setting	Make the settings for the indoor unit functions via the remote controller as necessary.				
	LOSSNAY setting (CITY MULTI only)	This setting is required only when the operation of CITY MULTI units is interlocked with LOSSNAY units.				
	Check	Error history: Display the error history and execute delete error history. Refrigerant leak check: Refrigerant leaks can be judged. Smooth maintenance: The indoor and outdoor maintenance data can be displayed. Request cord: Details of the operation data including each thermistor temperature and error history can be checked.				
	Self check	Error history of each unit can be checked via the remote controller.				
	Maintenance password	Take the following steps to change the maintenance password.				
	Remote controller check	When the remote controller does not work properly, use the remote controller checking function to troublushoot the problem.				

3-3. WIRED REMOTE CONTROLLER <PAR-21MAA>

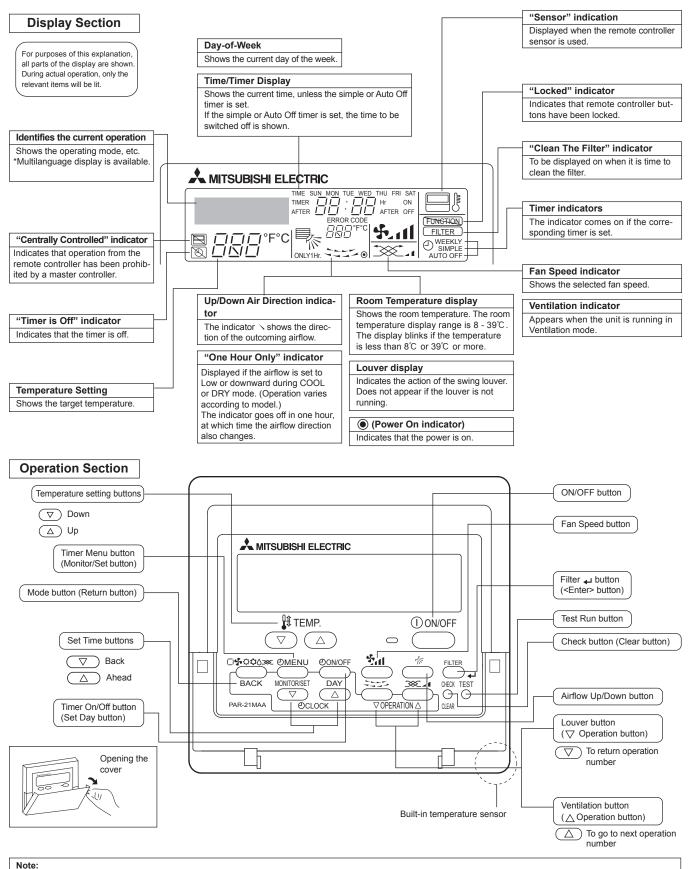

- "PLEASE WAIT" message
- This message is displayed for approximately 3 minutes when power is supplied to the indoor unit or when the unit is recovering from a power failure. • "NOT AVAILABLE" message

This message is displayed if an invalid button is pressed (to operate a function that the indoor unit does not have). If a single remote controller is used to operate multiple indoor units simultaneously that are different types, this message will not be displayed as far as any of the indoor units is equipped with the function.

4-1. SPECIFICATION

4

Item				PMFY-P20VBM-E PMFY-P25VBM-E PMFY-P32VBM-E PMFY-P40VB PMFY-P20VBM-E1 PMFY-P25VBM-E1 PMFY-P32VBM-E1 PMFY-P40VBI PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P32VBM-E#2 PMFY-P40VBI PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P32VBM-E#2 PMFY-P40VBI PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P32VBM-ER3 PMFY-P40VBI PMFY-P20VBM-ER4 PMFY-P25VBM-ER4 PMFY-P32VBM-ER4 PMFY-P40VBI						
	Powe	er	V∙Hz	:	Single phase 220V-230V-	240V 50Hz / 220V 60Hz	Z			
Coo	ling ca	apacity	kW	2.2	2.8 3.6 4.5					
Неа	iting ca	apacity	kW	2.5	3.2	4.0	5.0			
ristic	loout	Cooling	kW	0.042	0.044	0.044	0.054			
Electric characteristic	Input	Heating	kW	0.042	0.044	0.044	0.054			
ric ch	Current	Cooling	А	0.20	0.21	0.21	0.26			
Elect	Current	Heating	А	0.20	0.21	0.21	0.26			
	Exterio			Unit : Galv	anized sheets · Standard	l grilles : ABS resin acryli	c coating			
(mu	unsell sy	mbol)		Munsell <0.98Y 8.99/0	P·VBM-E#2/ER3/ER4)					
		Height	mm	230<30>						
Dime	ensions	Width	mm	812<1,000>						
		Depth	mm	395<470>						
Hea	at exch	anger	—	Cross fin						
	Fan	× No	—	Line flow fan × 1						
a D	Air flo	ow *3	m³/min	8.7 - 8.0 - 7.2 - 6.5	9.3 - 8.6	- 8.0 - 7.3	10.7 - 9.7 - 8.7 - 7.7			
ц	Exte static p		Pa		(0				
		motor tput	kW	0.028						
	Insula	tor	—	Polyethylene sheet						
	Air filt	er	—	PP honey comb fabric						
	Pipe	Gas side	ǿmm(in.)		12.7	(1/2")				
dime	ensions	Liquid side	ǿmm(in.)		6.35	(1/4")				
Field	d drain p	ipe size	ømm		O.D.26 (PVC pipe	VP-20 connectable)				
No	ise lev	el *3	dB	35 - 33 - 30 - 27	37 - 36	- 34 - 32	39 - 37 - 35 - 33			
Product weight kg				14<3.0>						

Note 1. Rating conditions (JIS B 8615-1)

Cooling: Indoor: D.B. 27°C W.B. 19°C

outdoor: D.B. 35°C

Heating: Indoor: D.B. 20°C

outdoor: D.B. 7°C W.B. 6°C

Note 2. The number indicated in < > is for the grille.


*3. Air flow and the noise level are indicated as High – Medium1 – Medium2 – Low.

4-2. ELECTRIC PARTS SPECIFICATIONS

Service ref. Parts name	Symbol	PMFY-P20VBM-E PMFY-P25VBM-E PMFY-P32VBM-E PMFY-P40VBM-E PMFY-P20VBM-E1 PMFY-P25VBM-E1 PMFY-P32VBM-E1 PMFY-P40VBM-E1 PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P32VBM-E#2 PMFY-P40VBM-E#2 PMFY-P20VBM-E#3 PMFY-P25VBM-E#3 PMFY-P32VBM-E#2 PMFY-P40VBM-E#2 PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P32VBM-ER3 PMFY-P40VBM-E#3 PMFY-P20VBM-ER4 PMFY-P25VBM-ER4 PMFY-P32VBM-ER3 PMFY-P40VBM-ER3								
Room temperature thermistor	TH21	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ								
Liquid pipe thermistor	TH22	Resistance 0°C/15kΩ, 10°C/9.6kΩ, 20°C/6.3kΩ, 25°C/5.4kΩ, 30°C/4.3kΩ, 40°C/3.0kΩ								
Gas pipe thermistor	TH23	Resistance 0°C /15kΩ, 10°C /9.6kΩ, 20°C /6.3kΩ, 25°C /5.4kΩ, 30°C /4.3kΩ, 40°C /3.0kΩ								
Fuse (Indoor controller board)	FUSE	250V 6.3A								
Fan motor	MF	DC Brushless Motor 8-pole OUTPUT 28W PN0H28-MB								
Vane motor	MV	MSFJC 20M23 12V/380Ω								
Drain pump	DP	PJV-1046 220-240V 50/60Hz								
Drain sensor	DS	Thermistor resistance 0°C/6kΩ, 10°C/3.9kΩ, 20°C/2.6kΩ, 25°C/2.2kΩ, 30°C/1.8kΩ, 40°C/1.3kΩ								
Linear expansion valve	LEV	DC12V Stepping motor drive, Port dimension ϕ 3.2 (0~2000pulse)								
Power supply terminal block	TB2	(L, N, ⁽¹⁾) 330V 30A								
Transmission terminal block	TB5	(M1, M2, S) 250V 20A								
MA-remote controller terminal block	TB15	(1,2) 250V 10A								

4-3. AIR CAPACITY TAKEN FROM OUTSIDE

PMFY-P·VBM-E series enables to take fresh air from outside. When taking fresh air, the duct fan is used. The air capacity should be 20% or less of the air flow SPEC(Hi).

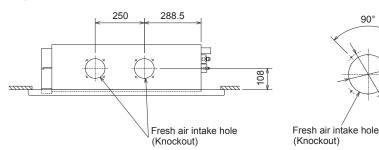

Service	Ref.	Air flow (Hi)	Air capacity from outside
PMFY-P20VBM-E PMFY-P20VBM-E1 PMFY-P20VBM-E#2	PMFY-P20VBM-ER3 PMFY-P20VBM-ER4	8.7m³/min	Max 1.74m³/min
PMFY-P25VBM-E PMFY-P25VBM-E1 PMFY-P25VBM-E#2	PMFY-P25VBM-ER3 PMFY-P25VBM-ER4	9.3m³/min	Max 1.86m³/min
PMFY-P32VBM-E PMFY-P32VBM-E1 PMFY-P32VBM-E#2	PMFY-P32VBM-ER3 PMFY-P32VBM-ER4	9.3m³/min	Max 1.86m³/min
PMFY-P40VBM-E PMFY-P40VBM-E1 PMFY-P40VBM-E#2	PMFY-P40VBM-ER3 PMFY-P40VBM-ER4	10.7m³/min	Max 2.14m³/min

Operation in conjunction with duct fan (Booster fan)

- Whenever the indoor unit is operating, the duct fun operates.
 - (1) Connect the optional multiple remote controller adapter (PAC-SA88HA-E) to the connector CN51 on the indoor controller board.
 - (2) Drive the relay after connecting the 12V DC relay between the Yellow and Orange connector lines.
 - (*) Use a relay of 1W or smaller.

Duct characteristics

How to read curves

at site

∢ 0

ш

OC307F

Curve in the


right graphs

 \bigcirc

1

(2)

MB: Electromagnetic switch power relay for duct fan. X: Auxiliary relay (12V DC LY-1F)

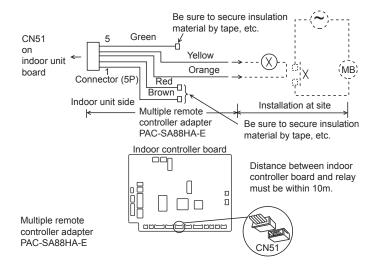



Unit : mm

4-ø2.8

φ100


90°



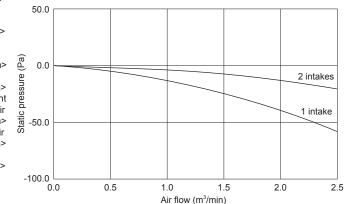

- Q...Designed amount of fresh air intake <m³/min> A...Static pressure loss of fresh air
 - intake duct system with air flow amount Q <Pa>
 - B...Forced static pressure at air conditioner inlet with air flow amount Q <Pa>
 - C...Static pressure of booster fan with air flow amount Q <Pa> D...Static pressure loss increase amount of fresh air intake duct system for air
 - flow amount Q <Pa> E...Static pressure of indoor unit with air flow amount Q <Pa>
 - Qa...Estimated amount of fresh air intake without D <m³/min>

4-4. NOISE CRITERION CURVES

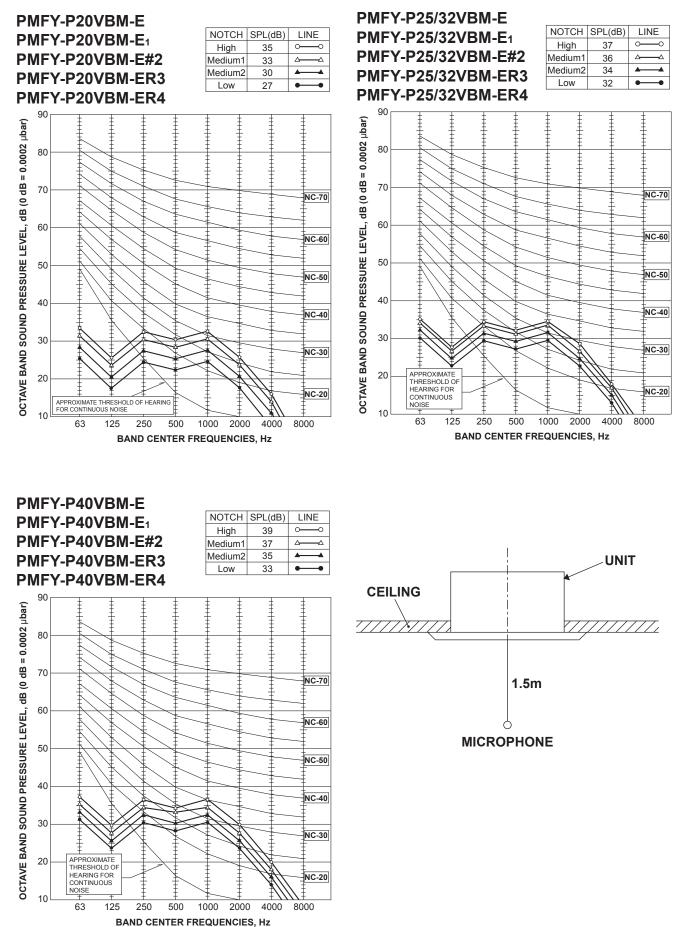


OC307F

15

OUTLINES AND DIMENSIONS

5

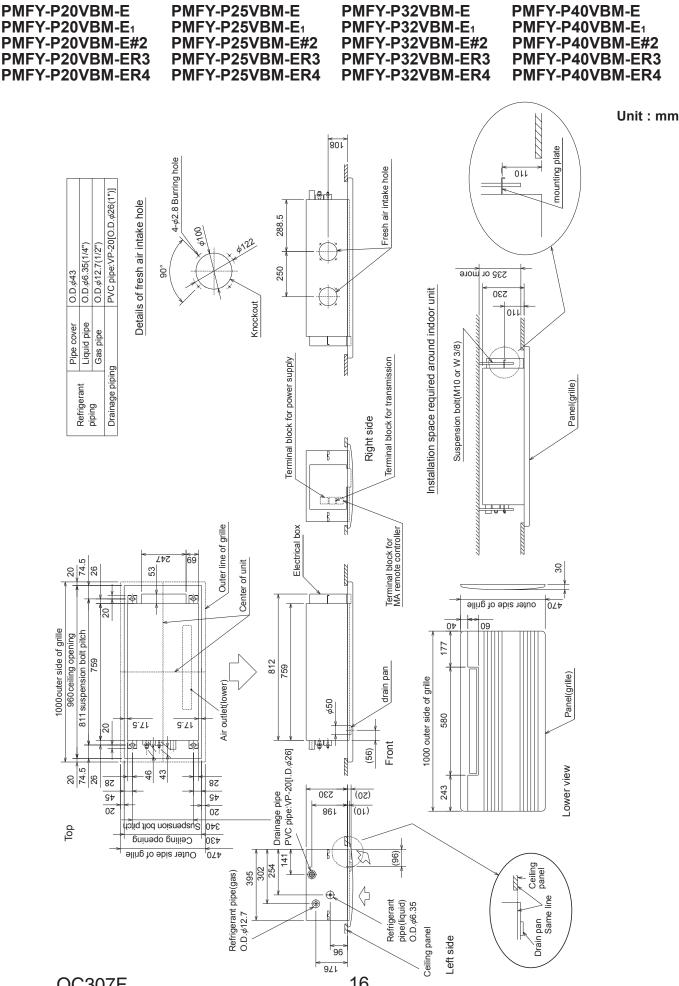

OC307F

16

6


WIRING DIAGRAM

PMFY-P20VBM-E

PMFY-P25VBM-E

PMFY-P32VBM-E

PMFY-P40VBM-E

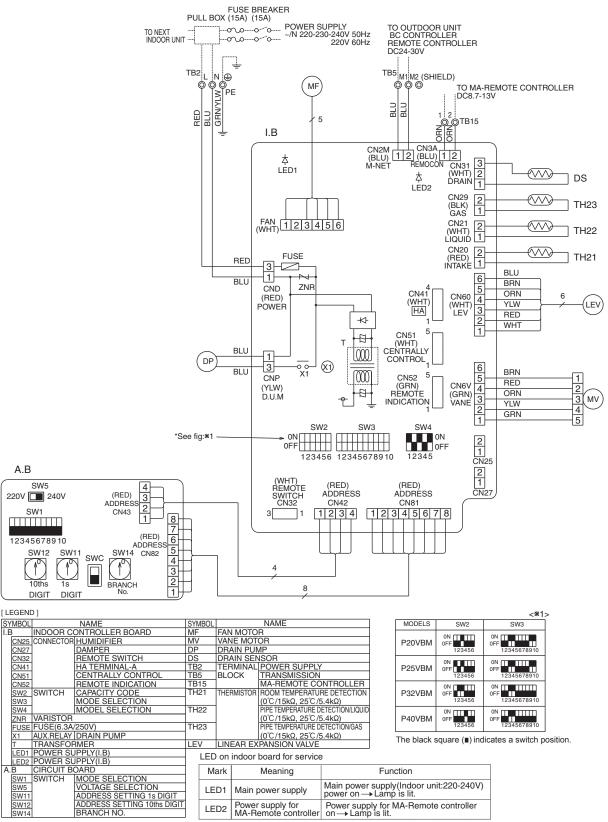

NOTES

1. At servicing for outdoor unit, always follow the wiring diagram of outdoor unit.

2. In case of using MA-Remote controller, please connect to TB15. (Remote controller wire is non-polar.)


3. In case of using M-NET, please connect to TB5.(Transmission wire is non-polar.)

4. Symbol [S] of TB5 is the shield wire connection.


When the power supply is 220 volts, set SW5 to 220V side.



PMFY-P40VBM-E1

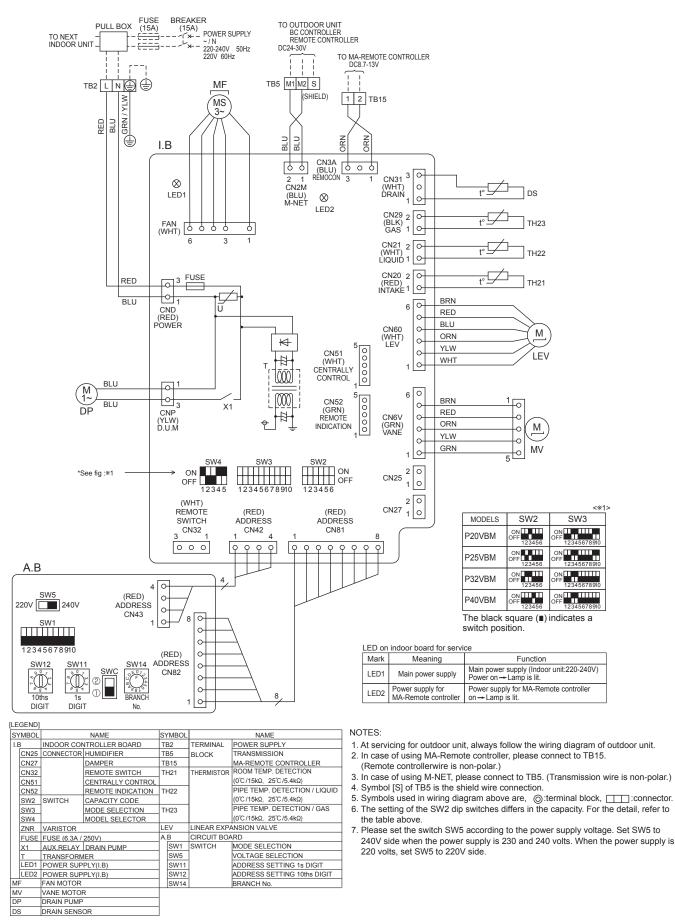

PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P32VBM-E#2 PMFY-P32VBM-ER3 PMFY-P40VBM-E#2 PMFY-P40VBM-ER3

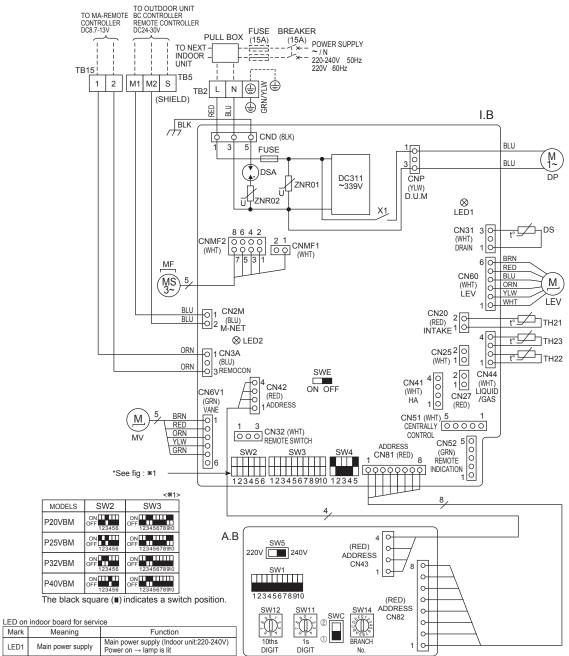

Mark	Meaning	Function	
LED1	Main power supply	Main power supply (Indoor unit:220-240V) Power on \rightarrow lamp is lit	
LED2	Power supply for MA-Remote controller	Power supply for MA-Remote controller on \rightarrow lamp is lit	


[LE	LEGEND]							
S	YMBOL		NAME	S١	MBOL		NAME	
1.1	В	INDOOR COM	NTROLLER BOARD	D	S	DRAIN SENS	OR	
	CN25	CONNECTOR	HUMIDIFIER	TE	32	TERMINAL	POWER SUPPLY	
	CN27		DAMPER	TE	35	BLOCK	TRANSMISSION	
	CN32		REMOTE SWITCH	TE	315		MA-REMOTE CONTROLLER	
	CN51		CENTRALLY CONTROL	TI	H21	THERMISTOR	ROOM TEMP. DETECTION	
	CN52		REMOTE INDICATION				(0°C/15kΩ, 25°C/5.4kΩ)	
	SW2	SWITCH	CAPACITY CORD	TI	122]	PIPE TEMP. DETECTION / LIQUID	
	SW3		MODE SELECTION	TH23			(0°C/15kΩ, 25°C/5.4kΩ)	
	SW4		MODEL SELECTOR]	PIPE TEMP. DETECTION / GAS	
	SWE		DRAIN UP MACHINE(TEST MODE)				(0°C/15kΩ, 25°C/5.4kΩ)	
	ZNR	VARISTOR			ΕV	LINEAR EXPANSION VALVE		
	FUSE	FUSE (T6.3A	L 250V)	A.	В	CIRCUIT BOA	ARD	
	X1	AUX.RELAY	DRAIN PUMP		SW1	SWITCH	MODE SELECTION	
	LED1	POWER SUP	PLY (I.B)		SW5		VOLTAGE SELECTION	
	LED2	POWER SUP	PLY (I.B)		SW11]	ADDRESS SETTING 1s DIGIT	
Μ	IF	FAN MOTOR			SW12	1	ADDRESS SETTING 10ths DIGIT	
M	V	VANE MOTOR			SW14		BRANCH No.	
D	P	DRAIN PUMP						

NOTES:

- At servicing for outdoor unit, always follow the wiring diagram of outdoor unit.
 In case of using MA-Remote controller, please connect to TB15.
- (Remote controller wire is non-polar.) 3.In case of using M-NET, please connect to TB5. (Transmission line is non-polar.) 4.Symbol (S) of TB5 is the shield wire connection.

- Symbols used in wining diagram above are,
 : terminal block, ooo: connecter.
 6. The setting of the SW2 dip switches differs in the capacity. For the detail, refer to the table below.
- 7.Please set the switch SWS according to the power supply voltage. Set SW5 to 240V side when the power supply is 230 and 240 volts. When the power supply is 220 volts, set SW5 to 220V side.

PMFY-P20VBM-ER4 PMFY-P25VBM-ER4

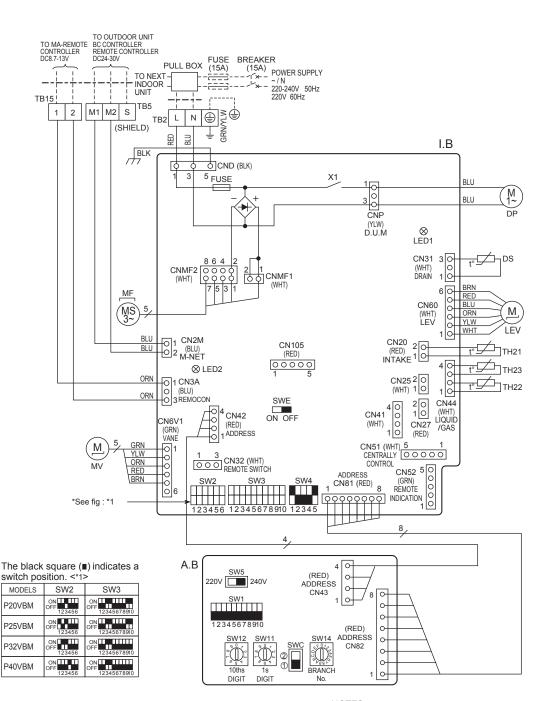

[LEGEND]

		JEND					
S	SYMBOL NAME		SY	MBOL	NAME		
1.6	3	INDOOR CONTROLLER BOARD			S	DRAIN SENS	OR
	CN25	CONNECTOR	HUMIDIFIER	TE	32	TERMINAL	POWER SUPPLY
	CN27		DAMPER	TE	35	BLOCK	TRANSMISSION
	CN32		REMOTE SWITCH	TE	315		MA-REMOTE CONTROLLER
	CN51		CENTRALLY CONTROL	Tŀ	H21	THERMISTOR	ROOM TEMP. DETECTION
	CN52		REMOTE INDICATION				(0°C/15kΩ, 25°C/5.4kΩ)
	CN105		IT TERMINAL		122		PIPE TEMP. DETECTION / LIQUID
	SW2	SWITCH CAPACITY CORD					(0°C/15kΩ, 25°C/5.4kΩ)
	SW3		MODE SELECTION	Tŀ	H23		PIPE TEMP. DETECTION / GAS
	SW4		MODEL SELECTOR				(0°C/15kΩ, 25°C/5.4kΩ)
	SWE		DRAIN UP MACHINE (TEST MODE)	LEV		LINEAR EXPANSION VALVE	
	FUSE	FUSE (T6.3AL 250V)			В	CIRCUIT BOARD	
	X1	AUX.RELAY	DRAIN PUMP		SW1	SWITCH	MODE SELECTION
	LED1	POWER SUP	PLY (I.B)		SW5		VOLTAGE SELECTION
	LED2	POWER SUP	OWER SUPPLY (I.B)		SW11]	ADDRESS SETTING 1s DIGIT
Μ	F	FAN MOTOR			SW12		ADDRESS SETTING 10ths DIGIT
Μ	V	VANE MOTOR			SW14		BRANCH No.
D	P	DRAIN PUMP					

NOTES:

- 1. At servicing for outdoor unit, always follow the wiring diagram of outdoor unit.
- In case of using MA-Remote controller, please connect to TB15. (Remote controller wire is non-polar.)
 In case of using M-NET, please connect to TB5. (Transmission line is non-polar.)
- 4. Symbol [S] of TB5 is the shield wire connection. 5. Symbols used in wiring diagram above are, _____: terminal block, ooo:connecter.
- 6. The setting of the SW2 dip switches differs in the capacity. For the detail,
- 7. Please set the switch SW5 according to the power supply voltage. Set SW5 to 240V side when the power supply is 230 and 240 volts. When the power supply is 220 volts, set SW5 to 220V side.

LED on indoor board for service

	Mark	Meaning	Function							
	LED1	Main power supply	Main power supply (Indoor unit:220-240V) Power on \rightarrow lamp is lit							
	LED2	Power supply for MA-Remote controller	Power supply for MA-Remote controller on \rightarrow lamp is lit							


REFRIGERANT SYSTEM DIAGRAM

PMFY-P20VBM-E PMFY-P20VBM-E1 PMFY-P20VBM-E#2 PMFY-P20VBM-ER3 PMFY-P20VBM-ER4

7

PMFY-P25VBM-E PMFY-P25VBM-E1 PMFY-P25VBM-E#2 PMFY-P25VBM-ER3 PMFY-P25VBM-ER4 PMFY-P32VBM-E PMFY-P32VBM-E1 PMFY-P32VBM-E#2 PMFY-P32VBM-ER3 PMFY-P32VBM-ER4

PMFY-P40VBM-E PMFY-P40VBM-E¹ PMFY-P40VBM-E#2 PMFY-P40VBM-ER3 PMFY-P40VBM-ER4

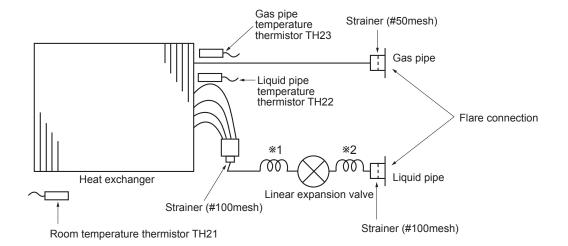

Unit: mm

		Unit. min				
	PMFY-P20, P25VBM-E	PMFY-P32, P40VBM-E				
	PMFY-P20, P25VBM-E1	PMFY-P32, P40VBM-E1				
	PMFY-P20, P25VBM-E#2	PMFY-P32, P40VBM-E#2				
	PMFY-P20, P25VBM-ER3	PMFY-P32, P40VBM-ER3				
	PMFY-P20, P25VBM-ER4	PMFY-P32, P40VBM-ER4				
Capillary tube *1	O.D. <i>φ</i> 4.6 × I.D. <i>φ</i> 3.4 × ℓ 200	O.D. <i>φ</i> 3.6 × I.D. <i>φ</i> 2.4 × ℓ 200				
Capillary tube *2	O.D. <i>φ</i> 3.6 × I.D. <i>φ</i> 2.4 × ℓ 80					


8-1. HOW TO CHECK THE PARTS PMFY-P20VBM-E PMFY-P20VBM-E1 PMFY-P20VBM-E#2 PMFY-P20VBM-ER3 PMFY-P20VBM-ER4

8

PMFY-P25VBM-E PMFY-P25VBM-E1 PMFY-P25VBM-E#2 PMFY-P25VBM-ER3 PMFY-P25VBM-ER4

PMFY-P32VBM-E PMFY-P32VBM-E1 PMFY-P32VBM-E#2 PMFY-P32VBM-ER3 PMFY-P32VBM-ER4 PMFY-P40VBM-E PMFY-P40VBM-E1 PMFY-P40VBM-E#2 PMFY-P40VBM-ER3 PMFY-P40VBM-ER4

Parts name	ame Check points										
Room temperature thermistor (TH21) Liquid pipe temperature	Disconnect the connector then measure the resistance with a tester. (At the ambient temperature 10° C - 30° C)										
thermistor (TH22)	Normal	A	bnormal				-l-t-il-				
Gas pipe temperature thermistor (TH23)	4.3kΩ~9.6kΩ	Ор	en or short	Refer to th	ie next pa	ige for the	details.				
Vane motor (MV)	Measure the resistan (At the ambient temp			Is with a tester.							
	Connector	No	ormal	Abnormal							
Red (4)	Brown — Yellow	_									
Brown 5	Brown — Red	- 380	Ω ±7%	Open or sho	ort						
① ③ Green Orange	Brown — Orange	-									
, i i i i i i i i i i i i i i i i i i i	Brown — Green										
Linear expansion valve(LEV)	Disconnect the connect Refer to the next pag	e for a de	etail.	resistance valve			٦				
(M) 6 Brown		Nor	-	(1) (2)	Abnormal		_				
2 2 1 2 Yellow 1 5 5 3 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1		?)-(6) w-Brown	(3)-(5) Orange-Red	(4)-(6) Blue-Brown	Open	or short	Refer to the next page for the details.				
000 Orange Red White		200Ω	±10%								
Drain pump (DP)	Measure the resistan (At the ambient temp			Is with a tester.							
Blue 1	Normal	A	bnormal								
Blue 3	400Ω~480Ω	Ор	en or short								
Drain sensor (DS)	Measure the resistance after 3 minutes have passed since the power supply was intercepted. (At the ambient temperature 0° C - 60° C)										
	Normal	A	bnormal								
	0.6kΩ~6.0kΩ	Ор	en or short	Refer to th	ne next p	age for the	e details.				

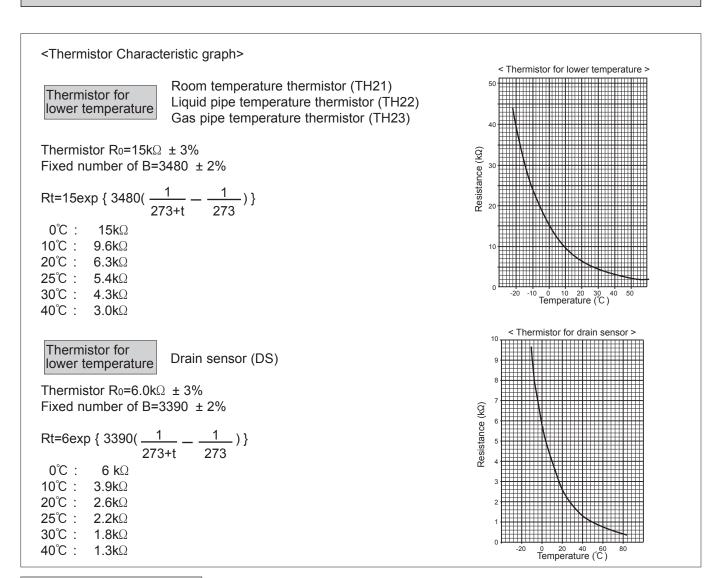


Linear expansion valve

① Operation summary of the linear expansion valve

• Linear expansion valve open/close through stepping motor after receiving the pulse signal from the indoor controller board.

• Valve position can be changed in proportion to the number of pulse signal.

<Connection between the indoor controller board and the linear expansion valve>

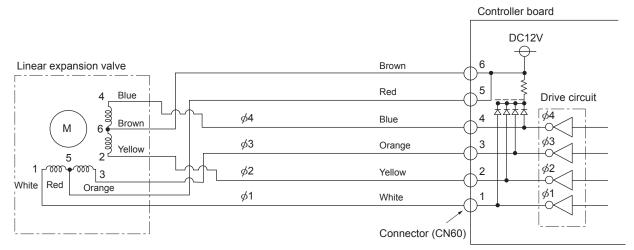


Note : Since the number of the connector at the controller board side and the relay connector are different, follow the colour of the lead wire.



<Output pulse signal and the valve operation>

Output		Output										
(Phase)	1	2	3	4								
ø1	ON	OFF	OFF	ON								
ø2	ON	ON	OFF	OFF								
<i>ø</i> 3	OFF	ON	ON	OFF								
<i>ø</i> 4	OFF	OFF	ON	ON								

② Linear expansion valve operation



Closing a value : $1 \rightarrow 2 \rightarrow 3 \rightarrow 4 \rightarrow 1$ Opening a value : $4 \rightarrow 3 \rightarrow 2 \rightarrow 1 \rightarrow 4$

The output pulse shifts in above order.

- When linear expansion valve operation stops, all output phase become OFF.
- At phase interruption or when phase does not shift in order, motor does not rotate smoothly and motor will lock and vibrate.
- When the switch is turned on, 2200 pulse closing valve signal will be send till it goes to (A) point in order to define the valve position.
- When the valve move smoothly, there is no sound or vibration occurring from the linear expansion valve : however, when the pulse number moves from (E) to (A) or when the valve is locked, more sound can be heard than normal situation.
- Sound can be detected by placing the ear against the screw driver handle while putting the screw driver to the linear expansion valve.

③ Troubleshooting


Symptom	Check points	Countermeasures
Operation circuit failure of the micro processor	Disconnect the connector on the controller board, then connect LED for checking. $\bigcirc 6$ $\bigcirc 6$ $\bigcirc 5$ $\bigcirc 4$ $\bigcirc 0$ $\bigcirc 3$ $\bigcirc 1$ $1k\Omega$ LED Pulse signal will be sent out for 10 seconds as soon as the main switch is turned on. If there is LED with lights on or lights off, it means the operation circuit is abnormal.	Exchange the indoor con- troller board at drive circuit failure.
Linear expansion valve mechanism is locked.	Motor will idle and make ticking noise when motor is operated while the linear expansion valve is locked. This ticking sound is the sign of the abnormality.	Exchange the linear expan- sion valve.
Short or breakage of the motor coil of the linear expansion valve	Measure the resistance between the each coil (red-white, red- orange, brown-yellow, brown-blue) with a tester. It is normal if the resistance is in the range of 200 $\Omega \pm 10\%$.	
Valve does not close completely (thermis- tor leaking).	To check the linear expansion valve, operate the indoor unit in fan mode and at the same time operate other indoor units in cooling mode, then check the pipe temperature <liquid pipe temperature> of the indoor unit by the outdoor multi controller board operation monitor. During fan operation, linear expan- sion valve is closed completely and if there are some leaking, detecting temperature of the thermistor will go lower. If the detected temperature indicated in the remote controller, it means the valve is not closed all the way. It is not necessary to exchange the linear expansion valve, if the leakage is small and not making any trouble.</liquid 	If large amount of refriger- ant is leaked, exchange the linear expansion valve.
Wrong connection of the connector or contact failure	Check the color of lead wire and missing terminal of the con- nector.	Disconnect the connector at the controller board, then check the continuity.

8-2. TROUBLESHOOTING

Check method of indoor fan motor (fan motor / controller board)

- 1 Notes
 - · High voltage is applied to the connecter (FAN)(CNMF1, 2) for the fan motor. Pay attention to the service.
 - Do not pull out the connector (FAN)(CNMF1, 2) for the motor with the power supply on, doing so may result in damage to the board.
- (FAN) PMFY-P20/25/32/40VBM-E PMFY-P20/25/32/40VBM-E1 (CNMF1, 2) PMFY-P20/25/32/40VBM-E#2 PMFY-P20/25/32/40VBM-ER3 PMFY-P20/25/32/40VBM-ER4
- ^② Self check

Symptom : The indoor fan can not rotate.

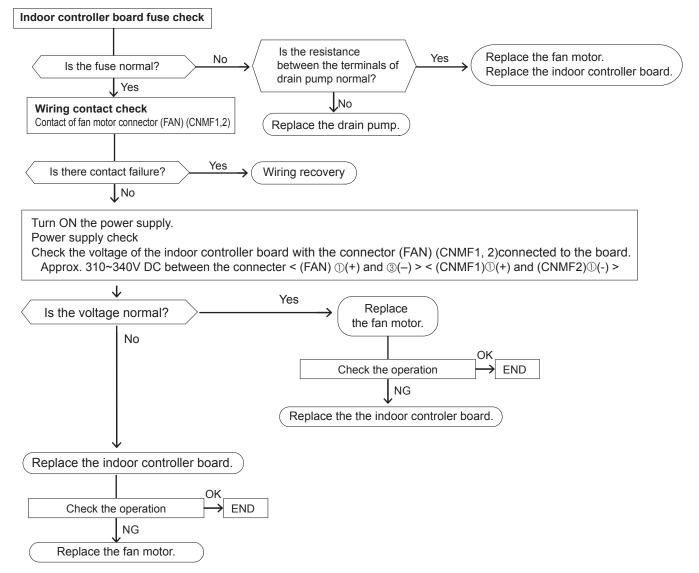

8-3. FUNCTION OF DIP SWITCH PMFY-P20VBM-E PMFY-P25VBM-E PMFY-P20VBM-E1 PMFY-P25VBM-E1 PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P20VBM-ER4 PMFY-P25VBM-ER4

PMFY-P32VBM-E PMFY-P32VBM-E1 PMFY-P32VBM-E#2 PMFY-P32VBM-ER3 PMFY-P32VBM-ER4



The black square (■) indicates a switch position.

Operation by switch Effective

Switch	Pole	Function				Operatio	on by switch	Effective	e Remarks		
	5.0				(NC	OFF	timing			
	1		tor <room tempe<br="">on> position</room>	rature	Bult-in remo	ote controller	Indoor unit		Address board		
	2	Filter c	logging detec	tion	Provided		Not provided		<initial setting=""></initial>		
	3	Filter cleaning sign			2,500h		100h				
	4	Fresh	air intake		Effective		Not effective		OFF 1 2 3 4 5 6 7 8 9 10		
SW1 Mode	5	Switchi	ng remote displ	ay	Thermo ON s	signal indication	Fan output indication	Under	*1		
Selection	6	Humid	ifier control		Fan operation	at Heating mod	e Thermo On operation at heating mod	suspension	SW 1-7 SW 1-8 SW 1-8		
	7	Air flow	v at		Low *1		Extra low *1		OFF OFF Extra low		
	8	Heat th	nermo OFF		Setting air f	flow	Depends on SW1-7		ON OFF Low OFF ON Setting air flow		
Mode Selection	9	Auto re	estart function		Effective		Not effective		ON ON stop		
	10	Power	source ON/O	FF	Effective		Not effective				
			Capacity		SW 2	Capacity	SW 2		Indoor controller board		
Capacity	1~6		P20	ON OFF	2 3 4 5 6	P32	ON OFF 1 2 3 4 5 6	Before power	<initial setting=""></initial>		
			P25	ON OFF	23456	P40	ON OFF 0 3 4 5 6	supply ON	Set for each capacity.		
	1	Heat pump / Cool only			Cooling onl	у	Heat pump		Indoor controller board		
	2	Louve	r		Available		Not available		Set while the unit is off.		
	3	Vane			Available		Not available		<initial setting=""></initial>		
	4	Vane swing function			Available		Not available		ON OFF		
	5	Vane h	norizontal angl	е	Second set	ting *4	First setting		1 2 3 4 5 6 7 8 9 10		
	6	Vane coo	oling limit angle set	ting *2	Horizontal a	angle	Down B, C	Under	*2 At cooling mode, each angle can be used only		
	7	Indoor l valve c	linear expansior	ı	Effective		Not effective	suspension	1 hour.		
Selection	8	Heatin	g 4deg. up		Not effectiv	е	Effective		*3 Please do not change SW3-9 and SW3-10.		
	9	Target	superheat setti	ng *3	-		_		See 6. WIRING DIAGRAM		
	10	Target	sub cool setti	ng *3	-		_		*4 Second setting means first setting.		
	1~5	PMF ON OFF	Y-P·VBM-E		PMFY-P·VB ON OFF 1 2 3		PMFY-P·VBM-E#2/ER3/ER4 ON OFF 1 2 3 4 5	Before power supply ON	Indoor controller board		


Switch	Pole	Operation by switch	Effective timing	Remarks
SW11 1s digit address setting SW12 10ths digit address setting	Rotary switch	SW12 SW11 How to set addresses $ \begin{array}{c} & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & \\ & & & &$		Address board <initial setting=""> SW12 SW11 $(\bigcirc \bigcirc$</initial>
SW14 Branch No. setting	Rotary switch	SW14 How to set branch numbers SW14 (Series R2 only) Match the indoor unit's refrigerant pipe with the BC controller's end connection number. Remain other than series R2 at "0".	Before power supply ON	Address board
SW5 Voltage Selection	2	220V 240V If the unit is used at the 230V or 240V area, set the voltage to 240V. If the unit is used at the 220V, set the voltage to 220V.		Address board <initial setting=""> 220V 240V</initial>

The black square (\blacksquare) indicates a switch position.

8-4. TEST POINT DIAGRAM 8-4-1. Indoor controller board PMFY-P20VBM-E PMFY-P25VBM-E PMFY-P20VBM-E1 PMFY-P25VBM-E1

PMFY-P32VBM-E PMFY-P32VBM-E1

PMFY-P40VBM-E PMFY-P40VBM-E1

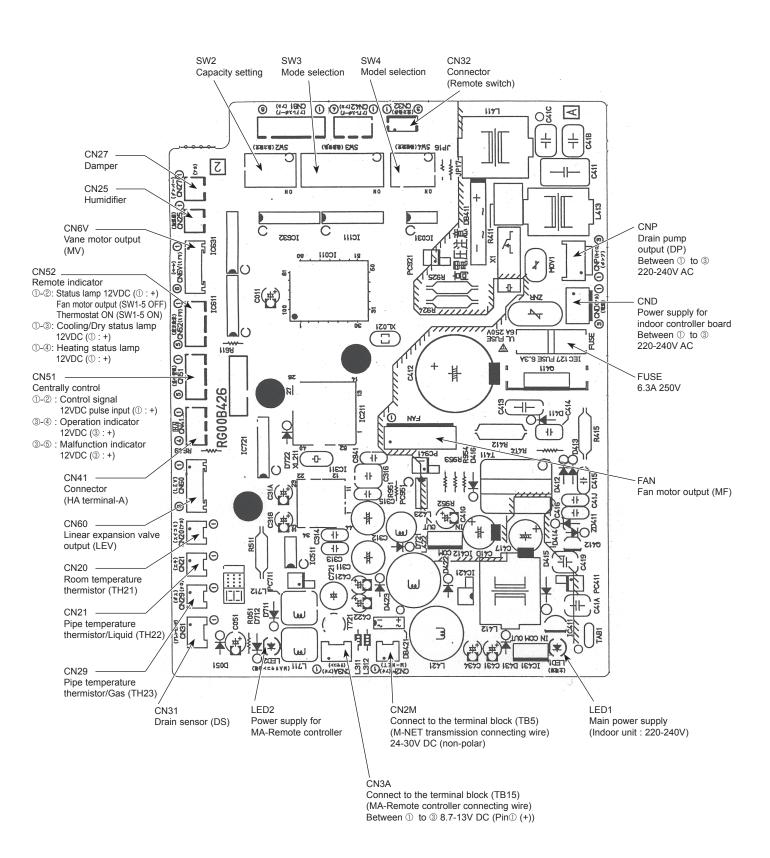


Indoor controller board PMFY-P20VBM-E#2 PMFY-P20VBM-ER3 PMFY-P20VBM-ER4


PMFY-P25VBM-E#2 PMFY-P25VBM-ER3 PMFY-P25VBM-ER4

PMFY-P32VBM-E#2 PMFY-P32VBM-ER3 PMFY-P32VBM-ER4


PMFY-P40VBM-E#2 PMFY-P40VBM-ER3 PMFY-P40VBM-ER4

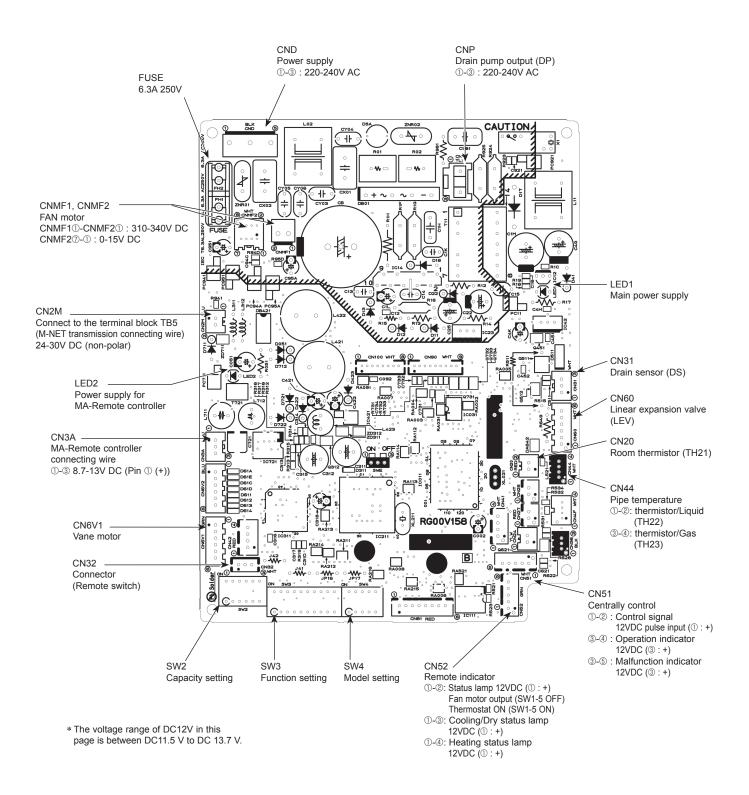

Indoor controller board PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P32VBM-E#2 PMFY-P40VBM-E#2 PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P32VBM-ER3 PMFY-P40VBM-ER3 PMFY-P20VBM-ER4 PMFY-P25VBM-ER4 PMFY-P32VBM-ER4 PMFY-P40VBM-ER4

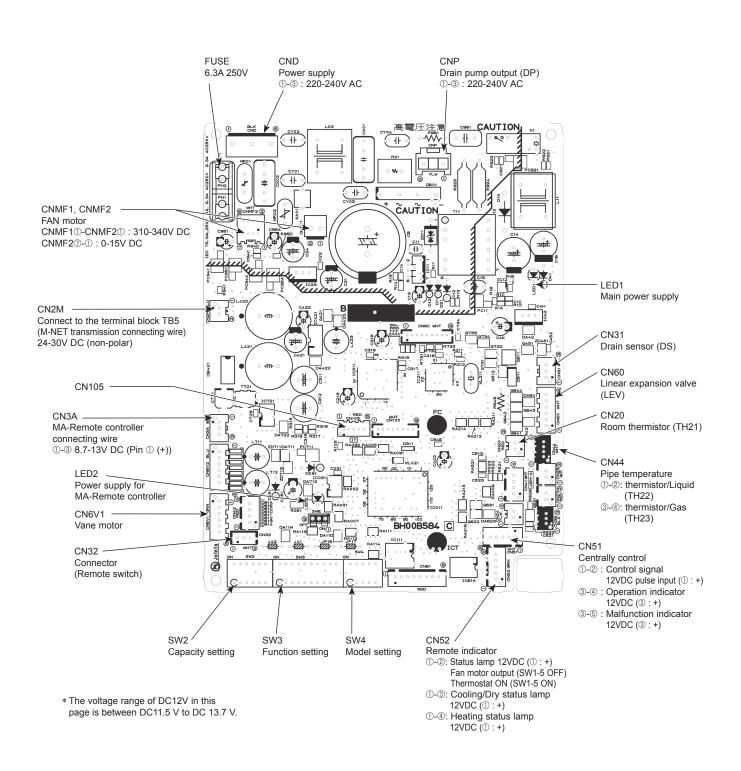

8-4-2. Address board PMFY-P20VBM-E PMFY-P25VBM-E PMFY-P32VBM-E PMFY-P40VBM-E PMFY-P20VBM-E1 PMFY-P25VBM-E1 PMFY-P32VBM-E1 PMFY-P40VBM-E1 PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P32VBM-E#2 PMFY-P40VBM-E#2 PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P32VBM-ER3 PMFY-P40VBM-ER3 PMFY-P20VBM-ER4 PMFY-P25VBM-ER4 PMFY-P32VBM-ER4 PMFY-P40VBM-ER4

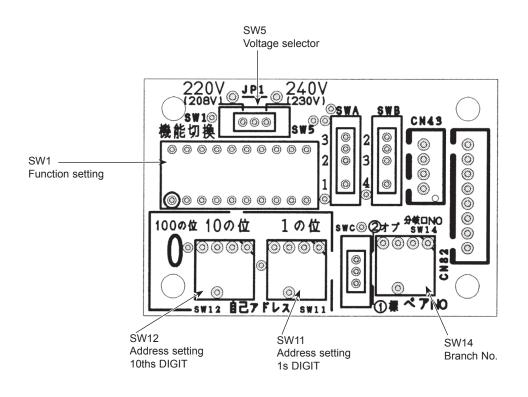

DISASSEMBLY PROCEDURE

PMFY-P20VBM-E PMFY-P20VBM-E PMFY-P20VBM-E#2 PMFY-P20VBM-ER3 PMFY-P20VBM-ER4


9


PMFY-P25VBM-E PMFY-P25VBM-E1 PMFY-P25VBM-E#2 PMFY-P25VBM-ER3 PMFY-P25VBM-ER4

PMFY-P32VBM-E PMFY-P32VBM-E1 PMFY-P32VBM-E#2 PMFY-P32VBM-ER3 PMFY-P32VBM-ER4

PMFY-P40VBM-E PMFY-P40VBM-E1 PMFY-P40VBM-E#2 PMFY-P40VBM-ER3 PMFY-P40VBM-ER4


Be careful when removing heavy parts.

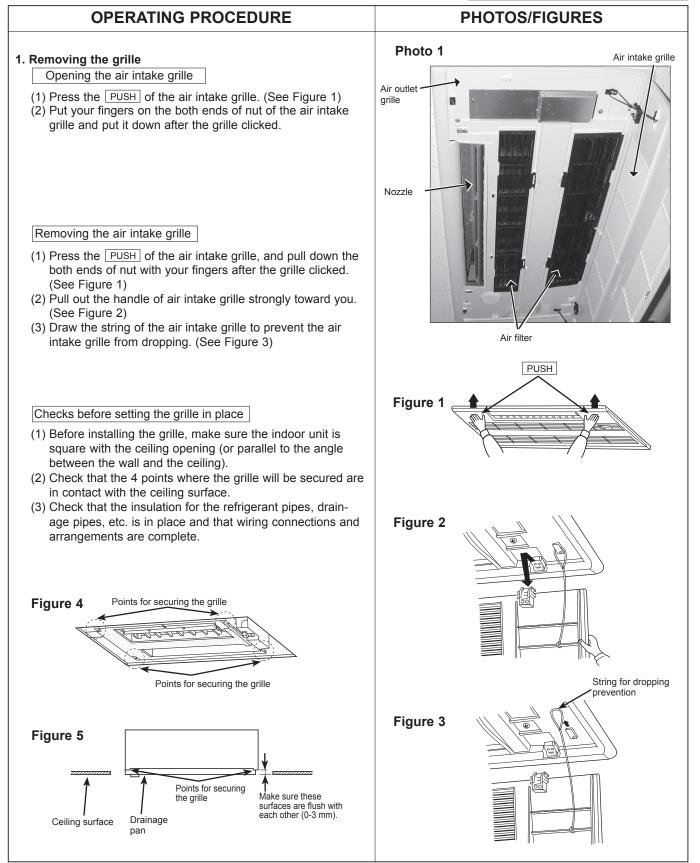


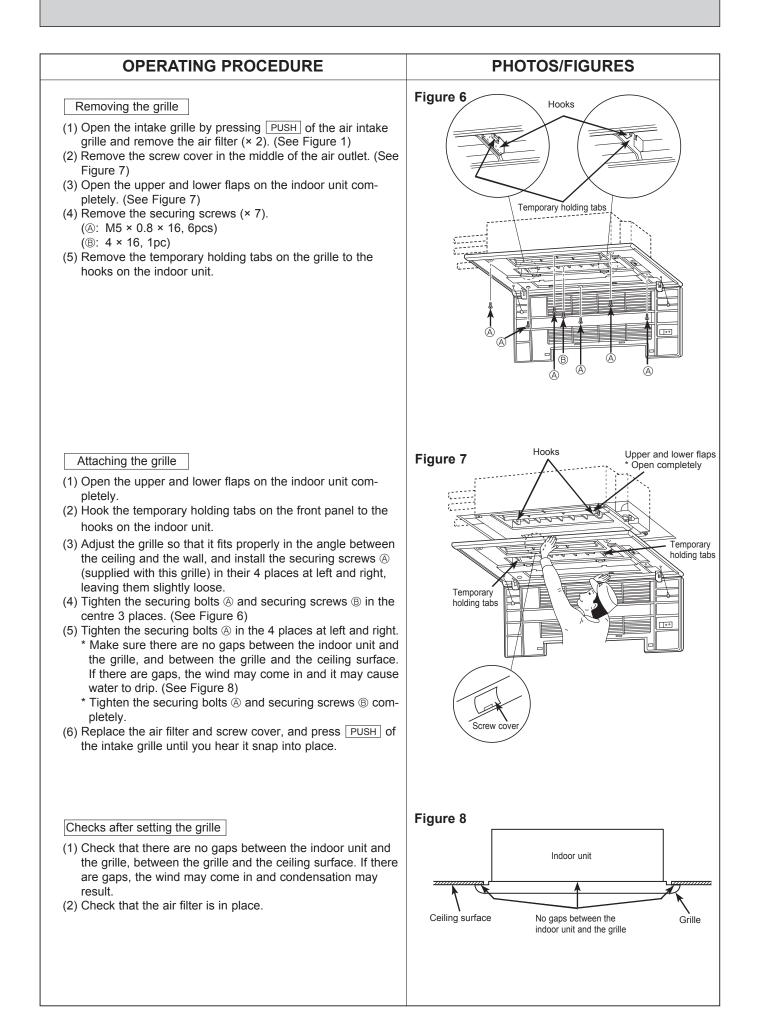

OC307F


33

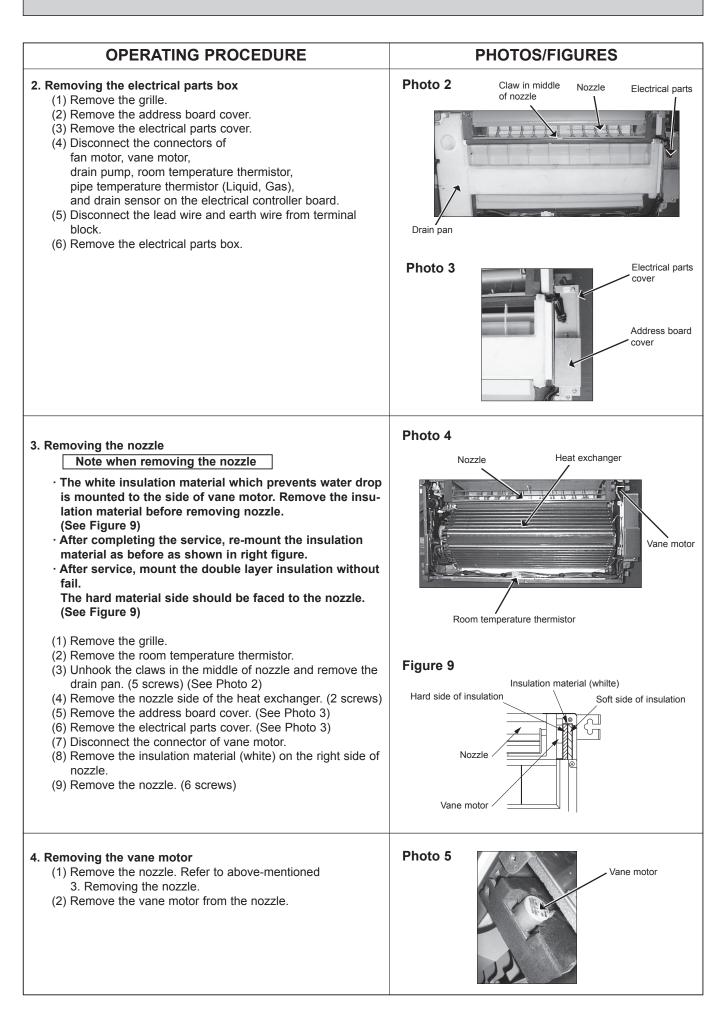

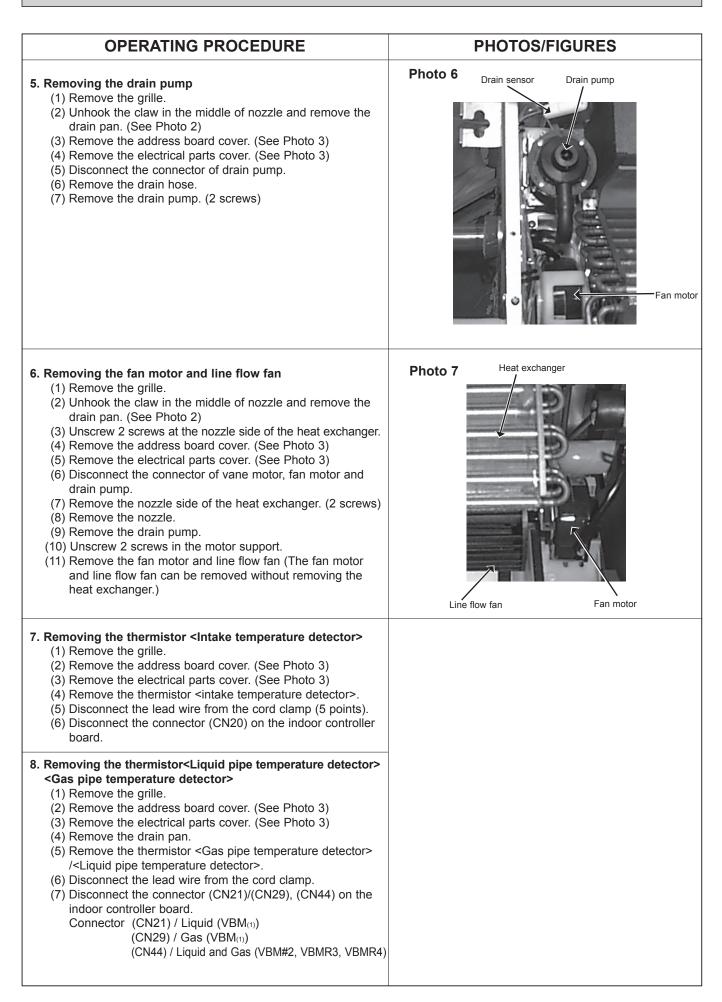

PANEL PARTS


PMP-40BM (FOR PMFY-P20/25/32/40VBM-E₍₁₎) PMP-40BMW (FOR PMFY-P20/25/32/40VBM-E#2, PMFY-P20/25/32/40VBM-ER3, PMFY-P20/25/32/40VBM-ER4)

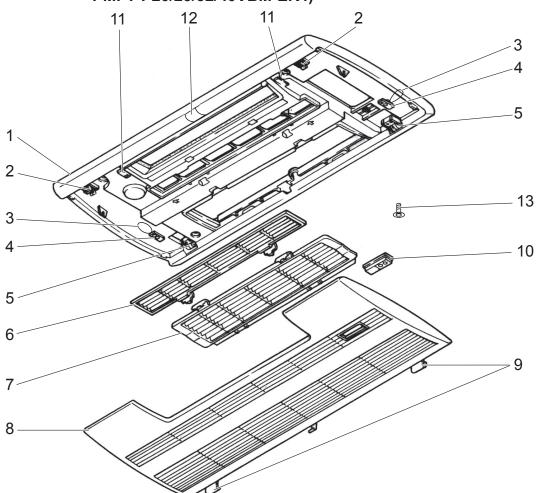


				Q'ty	//set		Wiring	Recommended	
No.	Part No.	Part Name	Specification	PMP- 40BM	PMP- 40BMW	Remarks (Drawing No.)	Diagram Symbol	Q'ty	
1	T7W E16 003	AIR OUTLET GRILLE		1					
'	T7W E22 003	AIR OUTLET GRILLE			1				
2	R01 E01 055	LATCH		2	2				
3	—	HANGER		2	2	(DT88D360H03)			
4	R01 E01 099	PANEL HOOK		2	2				
5	R01 E07 054	GRILLE CATCH		2	2				
6	R01 E32 500	FILTER (S)		1	1				
7	R01 E33 500	FILTER (L)		1	1				
8	T7W E04 691	INTAKE GRILLE		1					
ľ	T7W E06 691	INTAKE GRILLE			1				
9	R01 E06 054	GRILLE SHAFT		2	2				
10	R01 E01 648	RECEIVER COVER		1	1				
11	R01 E01 044	MAGNET		2	2				
12	R01 E04 096	SCREW CAP (WH)		1					
1 ¹²	R01 E07 096	SCREW CAP (WH)			1				
13	R01 E03 673	SCREW & WASHER		1	1	for PANEL			

ELECTRICAL PARTS

PMFY-P20VBM-E PMFY-P25VBM-E PMFY-P32VBM-E PMFY-P40VBM-E PMFY-P20VBM-E1 PMFY-P25VBM-E1 PMFY-P32VBM-E1 PMFY-P40VBM-E1 PMFY-P20VBM-E#2 PMFY-P25VBM-E#2 PMFY-P32VBM-E#2 PMFY-P40VBM-E#2 PMFY-P20VBM-ER3 PMFY-P25VBM-ER3 PMFY-P32VBM-ER3 PMFY-P40VBM-ER3 PMFY-P20VBM-ER4 PMFY-P25VBM-ER4 PMFY-P32VBM-ER4 PMFY-P40VBM-ER4

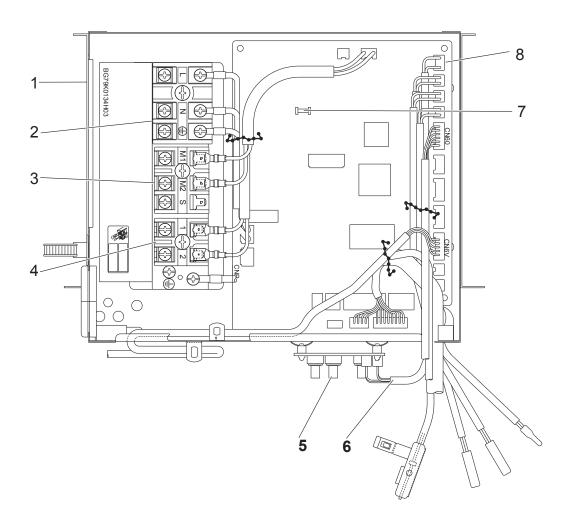

						Q'ty/set				Wiring
No.	Part No.	Part Name	Specification		PMF		Remarks (Drawing No.)	Diagram		
				VBM-E	VBM-E1	VBM-E#2	VBM-ER3	VBM-ER4	(21411191101)	Symbol
1	—	CONTROL BOX		1	1	1	1	1	(RG02B337G26)	
2	T7W E32 716	T.B./ L.N.E	3P (L,N,⊕)	1	1	1	1	1		TB2
3	T7W E35 716	T.B./ M1.M2.S	3P (M1,M2,S)	1	1	1	1	1		TB5
4	R01 E44 246	T.B./ 1.2	2P (1,2)	1	1	1	1	1		TB15
5	T7W E01 294	ADDRESS BOARD		1	1	1	1	1		A.B
6	R01 E10 304	ADDRESS CABLE(AB-IB)		1	1	1	1	1		
7	R01 E06 239	FUSE 6.3A 250V	6.3A 250V	1	1	1	1	1		FUSE
	T7W E66 310	CONTROLLER BOARD		1	1					I.B
8	R01 V84 310	CONTROLLER BOARD				1	1			I.B
	T7W C09 310	CONTROLLER BOARD						1		I.B

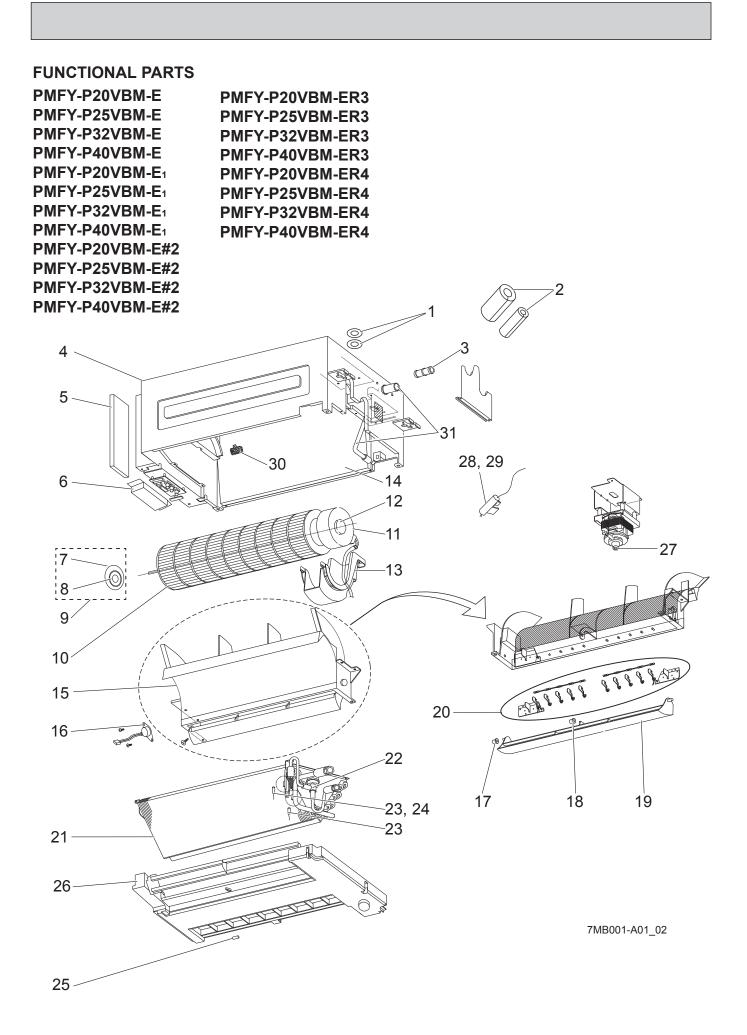

								Q'ty	/set						
								Remarks	Wiring						
No.	Part No.	rrt No. Part Name		VBM-E		VBM-E1		VBM	-E#2	VBM	-ER3	VBM-ER4			Diagram Symbol
				20,25	32,40	20,25	32,40	20,25	32,40	20,25	32,40	20,25	32,40		Symbol
1	R01 E13 097	WASHERS SET										1	1		
2	R01 E05 660	PIPE COVERS SET										1	1		
3	R01 18J 523	JOINT SOCKET								1	1	1	1		
4	_	CABINET		1	1	1	1	1	1	1	1	1	1	(DT00A478GB8)	
5	_	CONTROL BOX COVER		1	1	1	1	1	1	1	1	1	1	(RG02B668H01)	
6	_	ADDRESS BOARD COVER		1	1	1	1	1	1	1	1	1	1	(RG02L277H02)	
7	R01 H3A 102	BEARING MOUNT		1	1	1	1	1	1	1	1				
8	R01 E04 103	SLEEVE BEARING		1	1	1	1	1	1	1	1				
9	T7W H00 103	BEARING										1	1	BEARING& MOUNT SET	
10	R01 E32 114	LINE FLOW FAN		1	1	1	1	1	1	1	1	1	1		
	R01 E24 220	FAN MOTOR		1	1										MF
11	R01 E45 220	FAN MOTOR				1	1								MF
	R01 E49 220	FAN MOTOR						1	1	1	1	1	1		MF
12	R01 E13 105	RUBBER MOUNT		1	1	1	1	1	1	1	1	1	1	LEFT & RIGHT	
13	R01 E35 130	MOTOR SUPPORT		1	1	1	1	1	1	1	1	1	1		
14	R01 E05 110	CASING ASSY		1	1	1	1	1	1	1	1	1	1		
15	R01 H01 079	STABILIZER		1	1	1	1	1	1	1	1	1	1		
16	R01 E18 223	VANE MOTOR		1	1	1	1	1	1	1	1	1	1		MV
17	R01 E02 092	VANE SLEEVE		1	1	1	1	1	1	1	1	1	1		
18	R01 E03 092	VANE SLEEVE		1	1	1	1	1	1	1	1	1	1		
19	R01 E16 002	VANE		1	1	1	1	1	1	1	1	1	1		
20	R01 E03 038	GUIDE VANES SET		1	1	1	1	1	1	1	1	1	1		
	T7W H06 480	HEAT EXCHANGER		1		1									
	T7W H07 480	HEAT EXCHANGER			1		1								
21	T7W R94 480	HEAT EXCHANGER						1		1		1			
	T7W R95 480	HEAT EXCHANGER							1		1		1		
22	R01 H06 401	LEV-4/ EFM		1	1	1	1	1	1	1	1	1	1		LEV
	R01 H16 202	THERMISTOR	LIQUID	1	1	1	1								TH22
23	R01 N15 202	THERMISTOR	LIQUID/GAS					1	1	1	1	1	1		TH22/23
24	R01 H17 202	THERMISTOR	GAS	1	1	1	1								TH23
25	R01 H12 202	THERMISTOR (ROOM)	ROOM	1	1	1	1	1	1	1	1	1	1		TH21
26	R01 E30 529	DRAIN PAN		1	1	1	1	1	1	1	1	1	1		
27	T7W E09 355	DRAIN PUMP		1	1	1	1	1	1	1	1	1	1		DP
28	R01 E11 266	DRAIN SENSOR		1	1	1	1	1	1	1	1	1	1		DS
29	R01 32K 241	SENSOR HOLDER (DS)		1	1	1	1	1	1	1	1	1	1	for DS	
30	R01 E02 520	SENSOR COVER										1	1	for TH21	
	R01 E05 527	DRAIN PIPE ASSY		1	1	1	1	1	1						
31	R01 H10 527	DRAIN PIPE ASSY					İ			1	1	1	1		

CITY MULTI

MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE : TOKYO BUILDING., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO100-8310, JAPAN

©Copyright 2004 MITSUBISHI ELECTRIC CORPORATION Issued: Mar. 2019 No. OC307 REVISED EDITION-F Issued: Dec. 2012 No. OC307 REVISED EDITION-E Issued: Oct. 2009 No. OC307 REVISED EDITION-D PDF 7 Issued: Sep. 2008 No. OC307 REVISED EDITION-C PDF 7 Issued: Jul. 2007 No. OC307 REVISED EDITION-B PDF 8 Issued: Jul. 2006 No. OC307 REVISED EDITION-A PDF 8 Published: Apr. 2004 No. OC307 PDF 9 Made in Japan

Specifications are subject to change without notice.